

STANDARD DESIGN NOTES:

- THERE ARE A TOTAL OF 33 SINGLE RESIDENTIAL LOTS.
- REFER TO SPA DRAWING 2929-E01-E03 FOR COORDINATION WITH THE ELECTRICAL DESIGN.

LEGEND

PIT-ID 2	NBN Co PIT TYPE 2 PLASTIC PIT OR SIMILAR	ZERO LOT PROPERTY BOUNDARY
PIT-ID 5	NBN Co PIT TYPE 5 PLASTIC PIT OR SIMILAR	SHARED TRENCH
PIT-ID 6	NBN Co PIT TYPE 6 PLASTIC PIT OR SIMILAR	TRANSFORMER / KIOSK / PAD MOUNT SUB-STATION / POLE MOUNT TRANSFORMER
PIT-ID 8	NBN Co PIT TYPE 8 PLASTIC PIT OR SIMILAR	END CAP CONDUIT WITH STATION NO.
5	EXISTING TELSTRA PIT (2,3,4,5,6,7,8,9)	CAP SERVICE CONDUIT (P50/P20) P20=P23 mm NBNCo SERVICE CONDUIT
PIT-ID 8	EXISTING NBN Co PIT	LOCAL CONDUIT (P100/P50)
---	EXISTING CONDUIT	NBNCo STAGE BOUNDARY

CONDUIT CONFIGURATION

CONDUITS AND DUCTS ARE IN LAYER:
< L460 NBN Support - Underground >
AND TERMINOLOGY CATEGORISED INTO TWO GROUPS IN
THE DRAWINGS AS PER BELOW:
1-DUCT USED WITH LOCAL NETWORK
2-CONDUIT USED WITH LEAD-IN DROPS
ATTRIBUTES ATTACHED TO CONDUITS ARE AS SHOWN



- NOTE:**
- P100 HAS AN INTERNAL DIAMETER OF 104.9 mm AND A MINIMUM WALL THICKNESS OF 4.5 mm
 - P50 HAS AN INTERNAL DIAMETER OF 53 mm AND A MINIMUM WALL THICKNESS OF 3.1 mm
 - P20 HAS AN INTERNAL DIAMETER OF 23.3 mm AND A MINIMUM WALL THICKNESS OF 1.4 mm

SDU Development Information


Development Name: EAST POINT MACKAY	
Developer Company: EASTPOINT MACKAY PTY LTD	
Development Address: EAST POINT DRIVE, MACKAY HARBOUR, QLD 4740	
Authorised Rep: SPA Consulting Engineers (QLD)	
Phone: 07 4032 3311	
E-Mail: admin@spaconsulting.com.au	
nbn Reference Number: STG-M000078966	Stage Number: 1D
Design Revision: A	

BILL OF MATERIAL

NO OF LOTS: 33

PITS		DUCTS		MTRS
SIZE	QTY	SIZE	QTY	
2	4	P100	11	342.7
5	10	P50	4	105.7
6	0	P20	32	155
8	1			
9	0			

TOTAL NUMBER OF PITS: 15
TOTAL NUMBER OF MANHOLES: 0
TOTAL NUMBER OF CONDUITS: 47
TOTAL LENGTH OF CONDUITS: 603.4

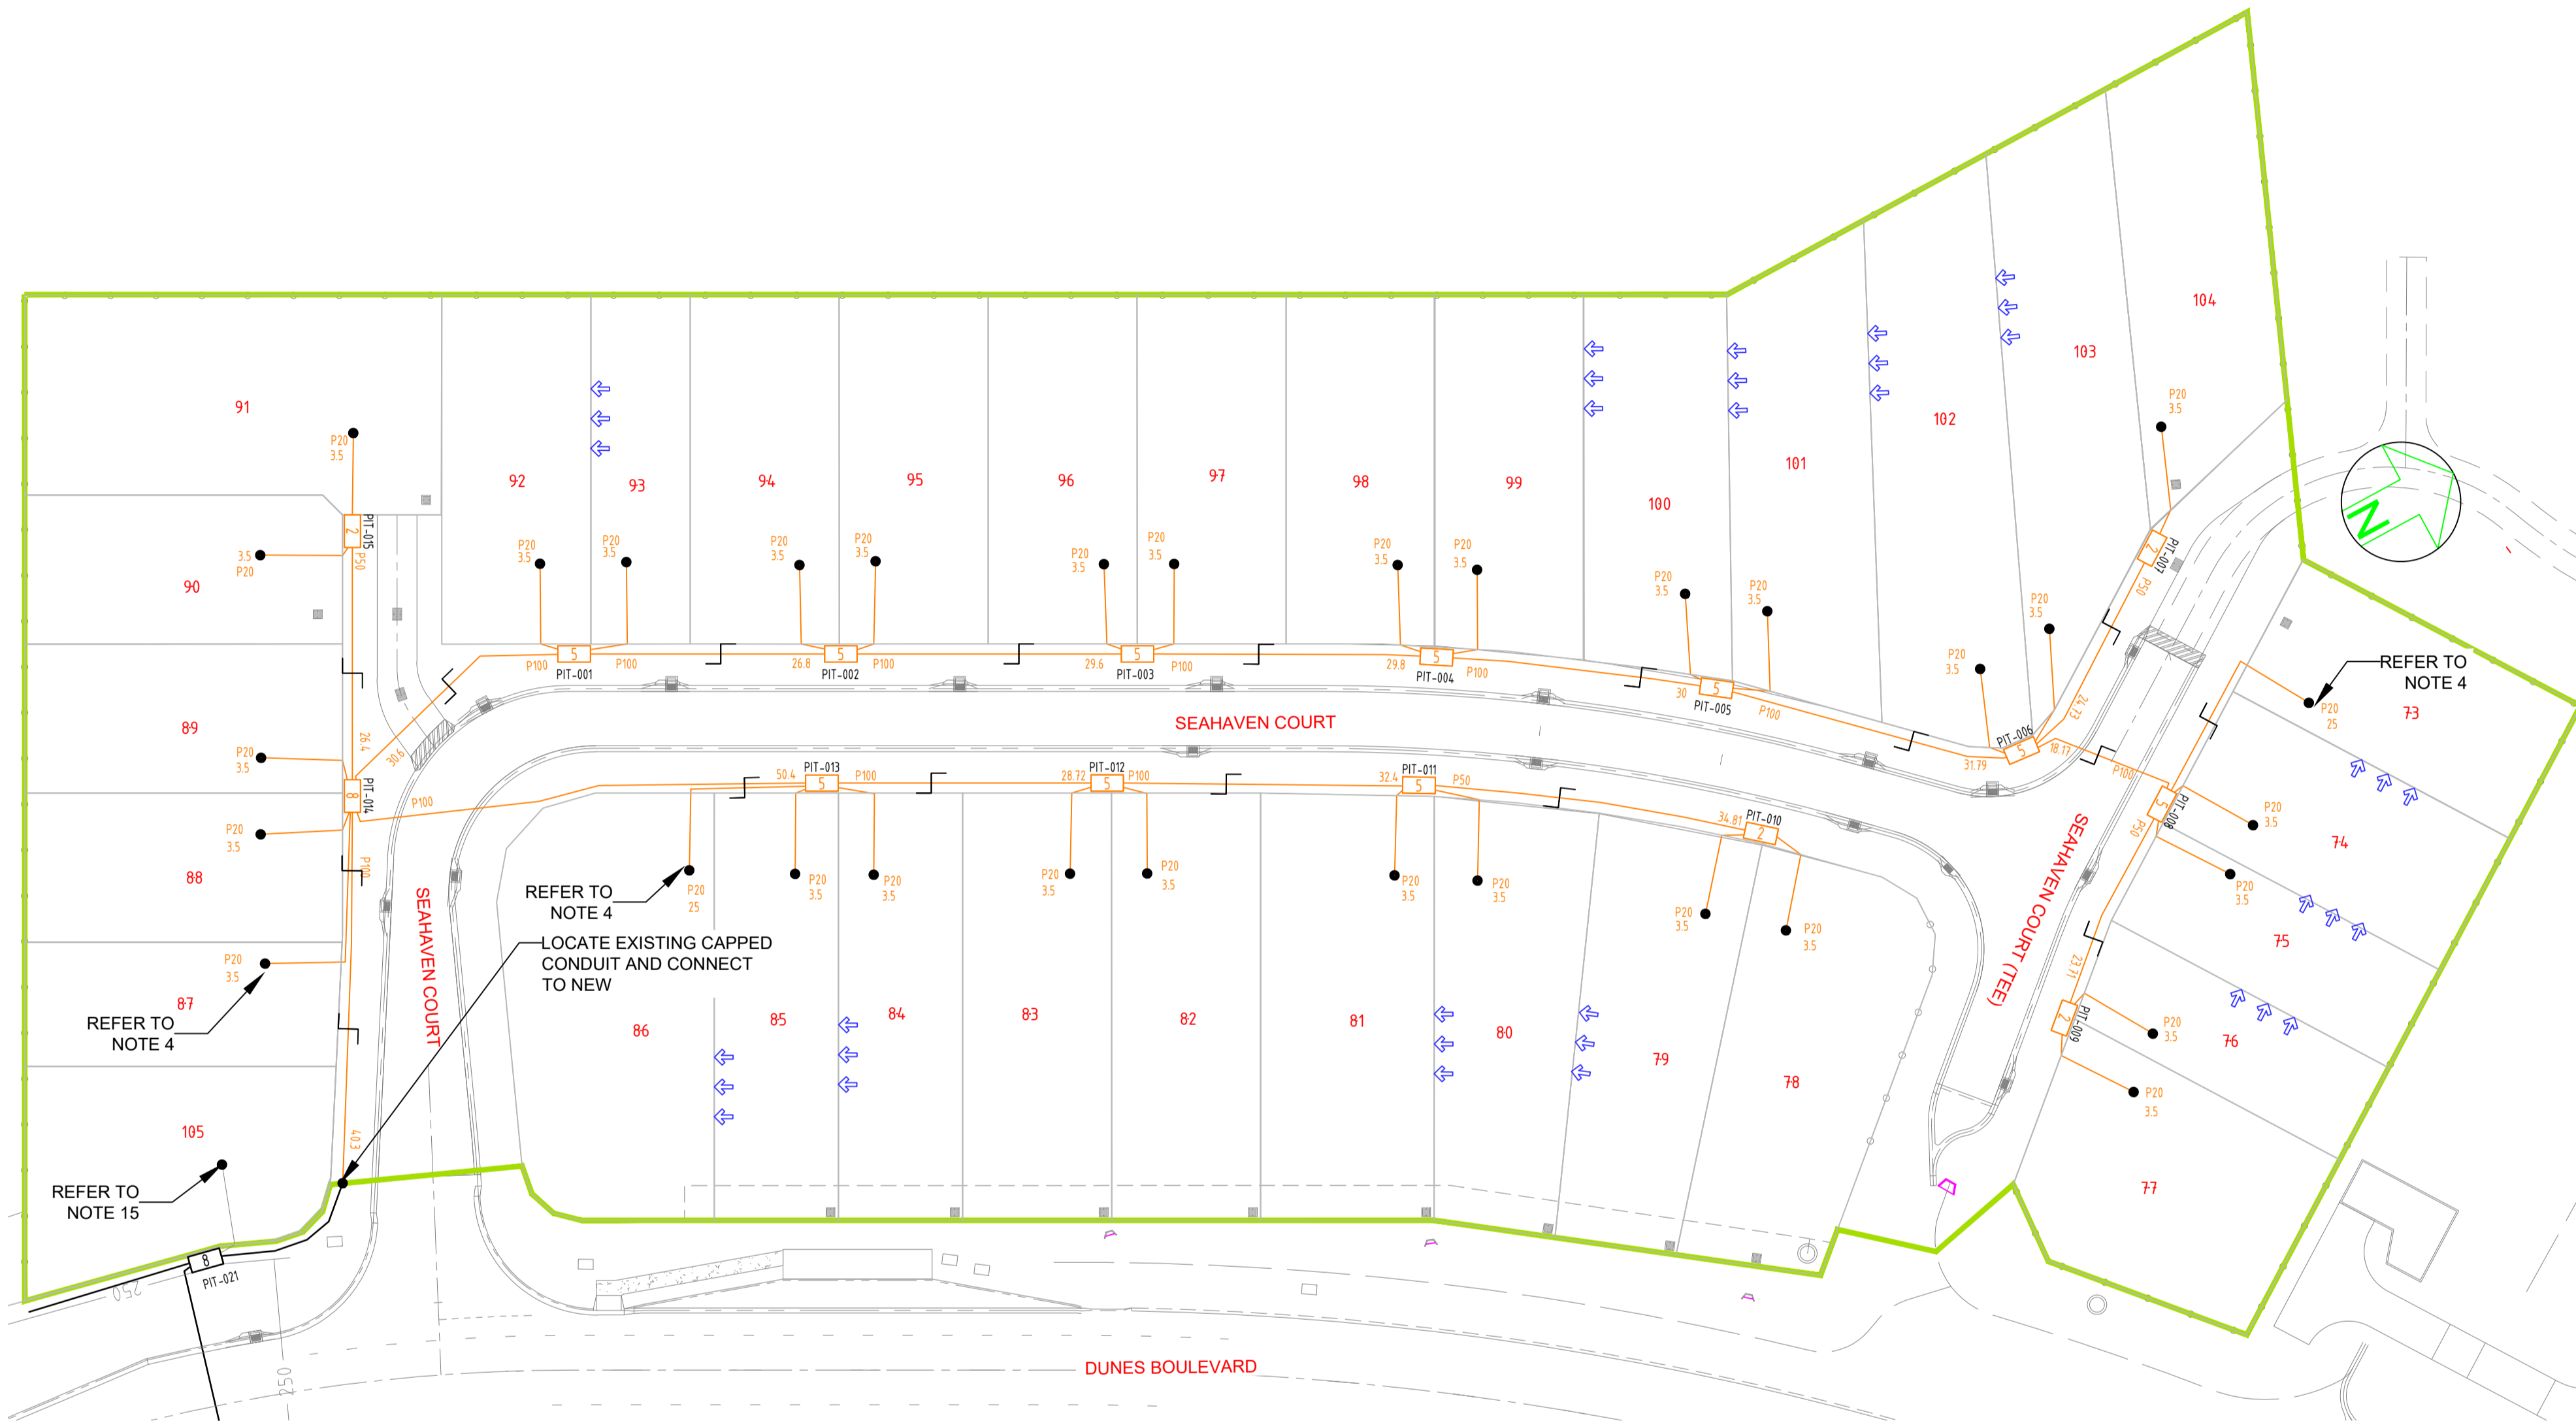

LAYOUT PLAN
SCALE 1:500 @ A1

FOR CONSTRUCTION

SAFETY FIRST
SAFETY STARTS WITH YOU

STAFF WORKING ON THIS ESTIMATE PLEASE
NOTE: The location of other authorities services
which may affect this work have not been obtained
by the estimator. Constructor to obtain service
information before commencing.

STANDARD CONSTRUCTION NOTES:

- REFER TO NBN Co DOCUMENT NO. NBN-TE-CTO-194 (DEPLOYMENT OF THE NBN Co CONDUIT AND PIT NETWORK - GUIDELINES FOR DEVELOPERS) FOR DETAILED CONSTRUCTION SPECIFICATION.
- MULTIPLE 15° CONDUIT BENDS TO BE USED TO SWING IN AND OUT OF THE STANDARD TRENCH ALIGNMENT AND ENTER THE NARROW ENDS OF THE PIT.
- PITS TO INCLUDE LID GASKET TO PREVENT DIRT ENTRY AND SPREADER BARS TO PREVENT PIT BUCKLING DURING BACKFILL / GROUND COMPACTION. PIT LIDS TO BE EMBOSSED WITH "NBN" AND COMPLY AS PER CLAUSE 5.3.2 OF THE ABOVE NBN Co DOCUMENT.
- SERVICE CONDUITS TO EXTEND 1m INSIDE THE FRONT PROPERTY BOUNDARY. REFER EXTENDED SERVICE CONDUIT DETAIL FOR DISTANCES FROM DIVIDING PROPERTY BOUNDARY FOR BOUNDARIES WITHOUT PIT. CONTRACTORS TO TIE TELECOMMUNICATIONS CAUTION TAPE TO END OF SERVICE CONDUITS AND EXTEND TO ABOVE GROUND LEVEL FOR FUTURE CONDUIT LOCATION.
- ALL CONDUITS TO ENTER AND EXIT AT NARROW ENDS OF PITS ONLY. LOCATE CONDUITS AS CENTRALLY IN PIT END WALLS AS POSSIBLE. CONDUITS SHALL NOT BE INSTALLED WITHIN 50 mm OF ANY CORNER OF THE PIT. MINIMUM SEPARATION BETWEEN CONDUITS TO BE 25 mm. INSTALL CONDUITS AND CONDUIT COLLARS (BUSHES) TO BE SQUARE AND FLUSH WITH THE PIT END WALL. REFER TO THE PIT END WALL DETAILS IN THIS DESIGN FOR ADDITIONAL REQUIREMENTS.
- MINIMUM COVER TO BE: 300 mm FOR SERVICE DROP CONDUITS, 450 mm IN VERGE, 600 mm UNDER LOCAL ROADS, AND 800 mm UNDER MAIN ROADS.
- CONDUITS ARE TO BE CLEANED AND PROVEN USING A MANDREL. AFTER TESTING INSTALL A SUITABLE DRAW ROPE TO ALL CONDUITS AND CAP CONDUIT ENDS. SEAL CONDUITS AT PITS TO PREVENT ENTRY OF DUST AND MOISTURE. SERVICE CONDUIT DRAW ROPES TO BE ADDITIONALLY FITTED WITH A PLASTIC LABEL AT PIT END, IDENTIFYING LOT NUMBER AND DISTANCE / DIRECTION FROM BOUNDARY.
- INSTALL NON CONDUCTIVE (METAL FREE) MARKER TAPE ABOVE ALL NBN Co CONDUITS, 300 mm BELOW FINISHED GROUND LEVEL. INSTALL METALLIC KERB MARKERS AT ROAD CROSSINGS.
- REFER TO ERGON ENERGY STANDARD DRAWINGS 5228 AND 5168 SHEETS 1 TO 3 FOR SHARED TRENCH CROSS SECTIONS.
- GRADE TOP OF PIT TO MATCH VERGE / FOOTPATH.
- WHERE REQUIRED, SUPPLY AND INSTALL SERVICE AND ROAD CROSSING CONDUITS SHOWN IN THE SITE PLAN.
- WHERE CONDUIT BURIAL DEPTH IS LESS THAN THAT SPECIFIED IN THE NBN Co DEPLOYMENT OF CONDUIT AND PIT NETWORK GUIDELINES, SUPPLY AND INSTALL CONCRETE COVER (FOR VERGE AND FOOTPATH) / CONCRETE ENCASMENT (FOR ROADWAYS) ENSURE THAT MINIMUM SEPARATION TO ALL OTHER SERVICES ARE MAINTAINED.
- WHERE SPECIFIED ON THE SITE PLAN, NBN Co CONDUIT TO BE INSTALLED UNDERNEATH STORM WATER. REFER TO THE NBN Co DEPLOYMENT OF CONDUIT AND PIT NETWORK GUIDELINES FOR THE MINIMUM CLEARANCES REQUIRED.
- SUPPLY AND INSTALL ADDITIONAL DEVIATING CONDUIT BENDS TO ACHIEVE THE INCREASED / DECREASED BURIAL DEPTH REQUIRED TO AVOID CLASH WITH OTHER SERVICES.
- CONDUIT INSTALLED IN PREVIOUS THIS STAGE. FIBRE TO BE RETICULATED IN THIS STAGE.



REV	DATE	DRAFTER	DESCRIPTION	APPROVED
A	10/06/22	MD	FOR CONSTRUCTION	NBNCo
1	23/10/21	MD	FOR APPROVAL	JE

STRICTLY CONFIDENTIAL

NBNCO APPROVAL RECORD:

<input type="checkbox"/> DD	SIGNATURE	DATE
<input type="checkbox"/> WD		
<input type="checkbox"/> AB		

QUALITY RECORD:

NBNCO DISCLAIMER
THIS DOCUMENT HAS BEEN PREPARED SOLELY FOR THE USE OF NBNCO LIMITED (ABN 86 136 533 741) FOR USE IN MAINTAINING NBNCO FACILITIES. IT HAS NOT BEEN CREATED FOR ANY OTHER USE. IT SHOULD NOT BE SCALED TO LOCATE NBNCO ASSETS. NO WARRANTY IS GIVEN THAT THE INFORMATION IS ACCURATE OR COMPLETE.



KEY PLAN

DRAWING TITLE: EASTPOINT STAGE 1D NBNCo PIT AND PIPE DESIGN LAYOUT PLAN	
ENABLE#:	
STATE: QLD	REGION: MK
FSA:	SAM: ADA:
PROJECT No: STG-M000078966	
CADREF No: 2929-T01	
SCALE AS SHOWN	SHEET No. 1 OF 2
	REV. A